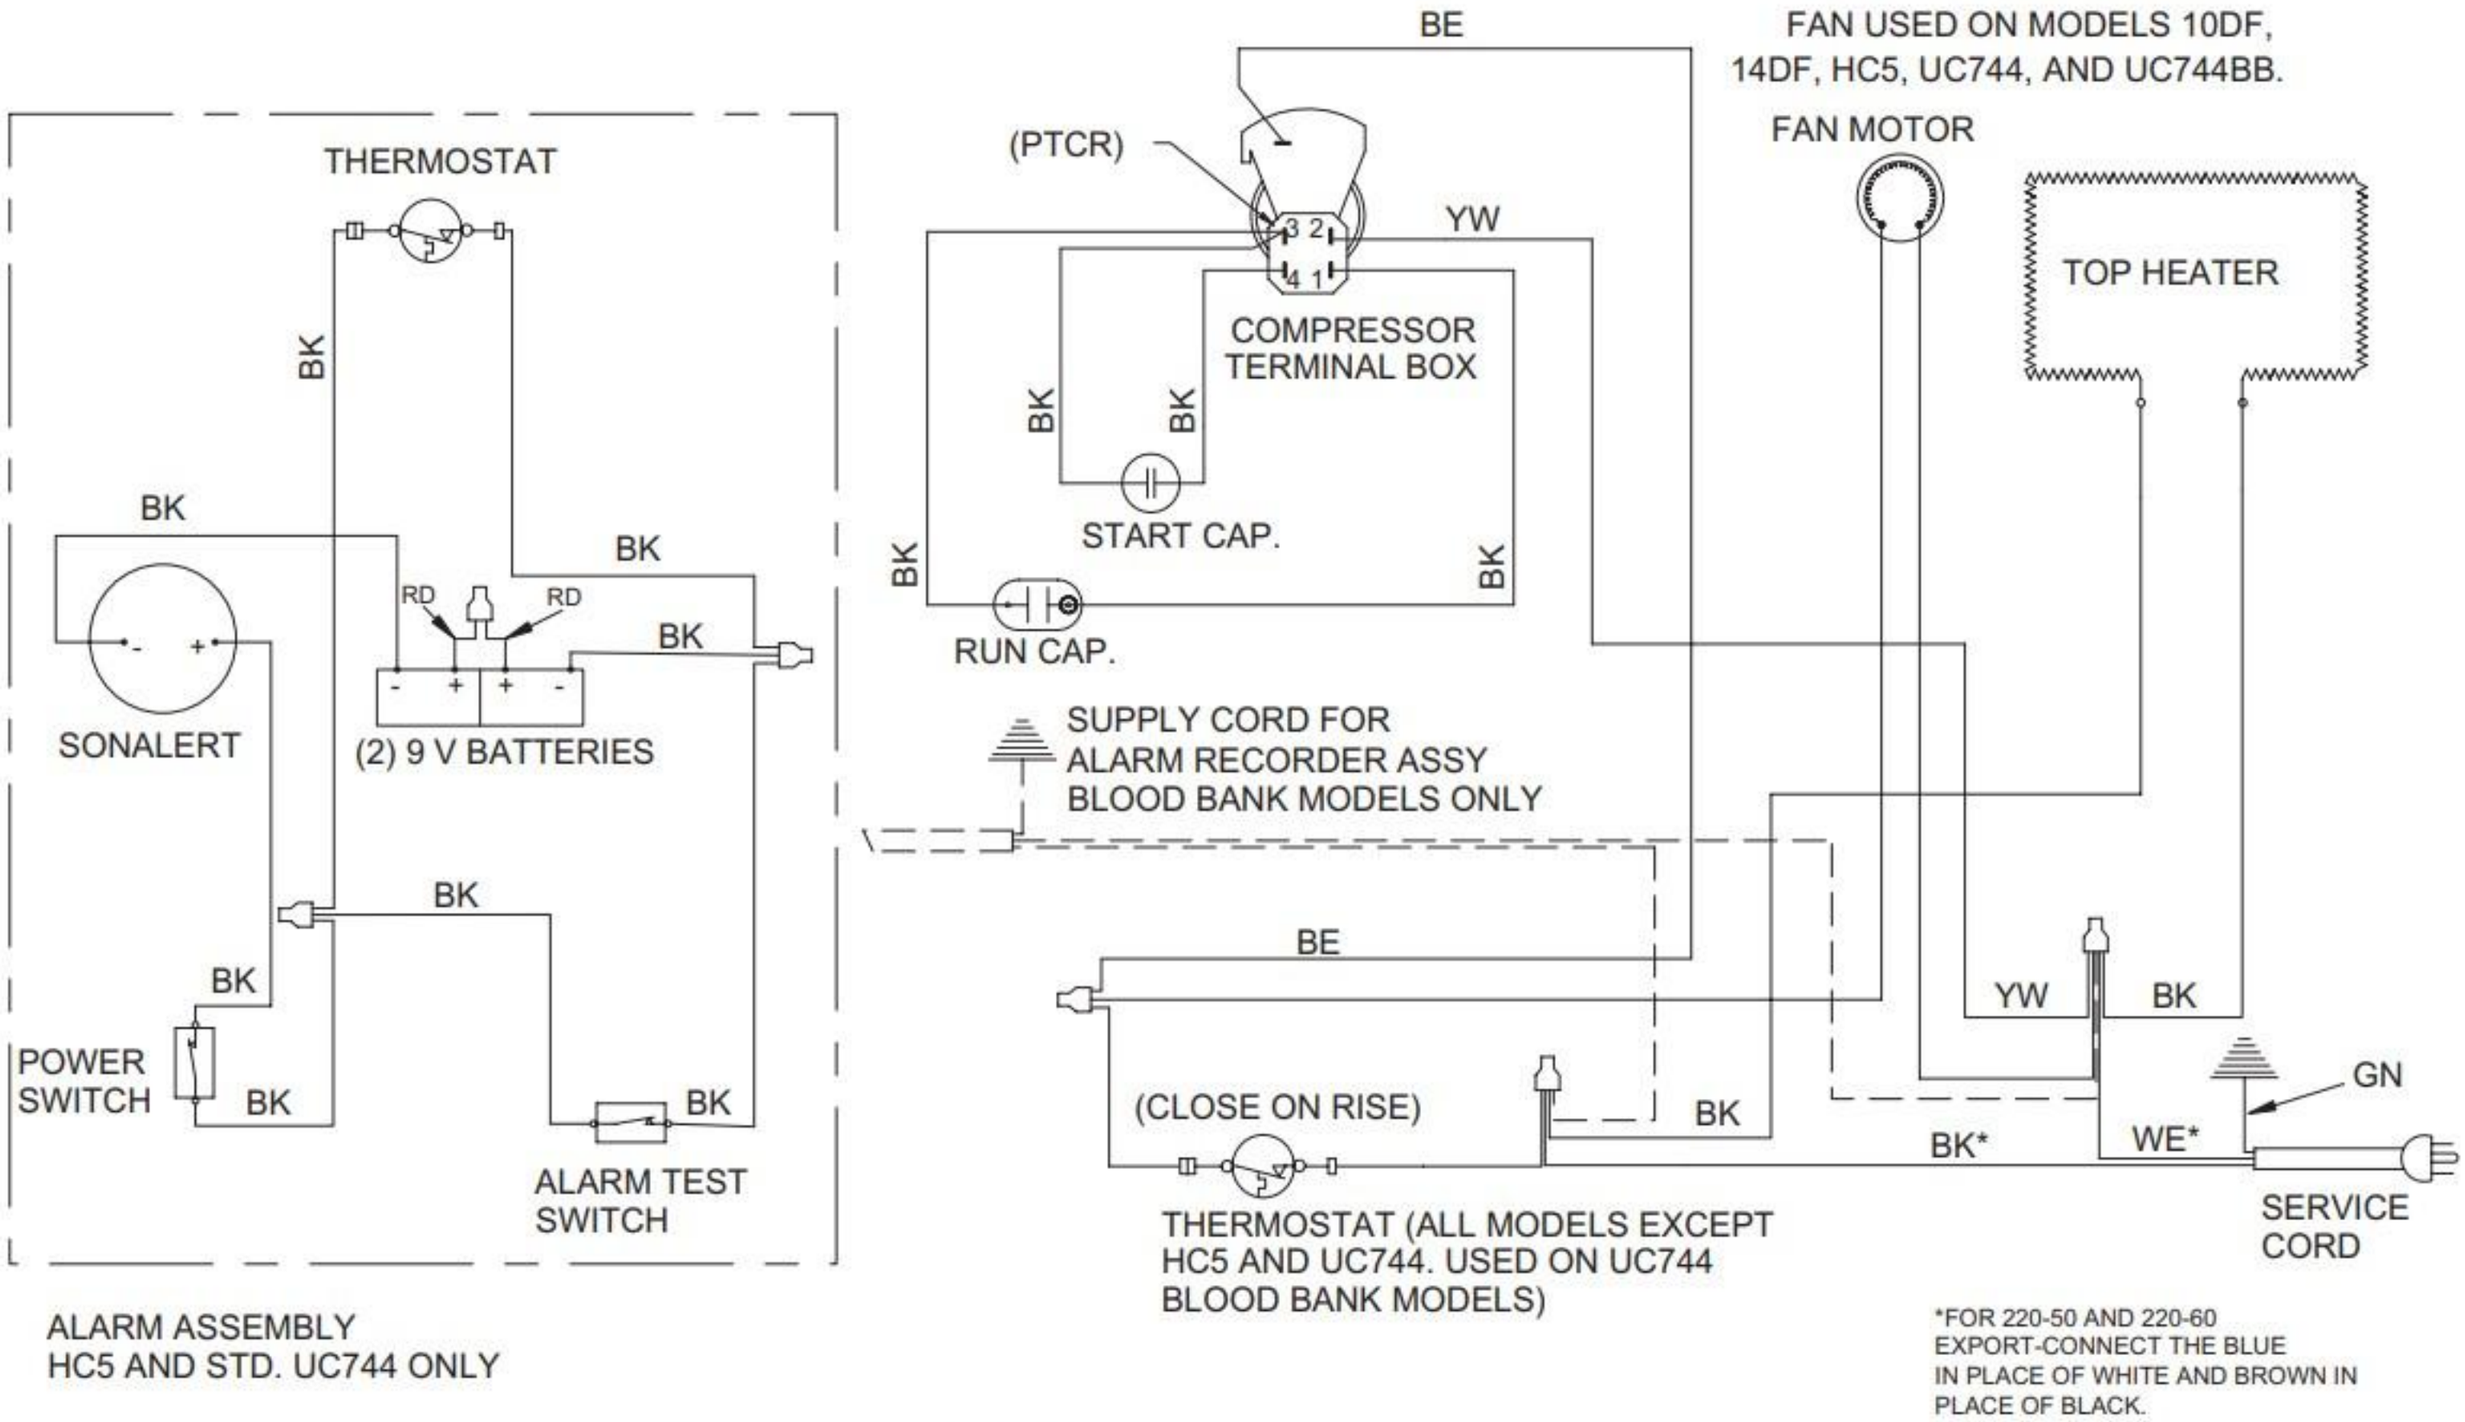

SEE ELECTRICAL RATING PLATE FOR SUPPLY VOLTAGE AND FREQUENCY.

NOTE:
CABINET MUST BE GROUNDED.
USE COPPER CONDUCTORS ONLY.

26-0959-00 REV. E