


PR Series

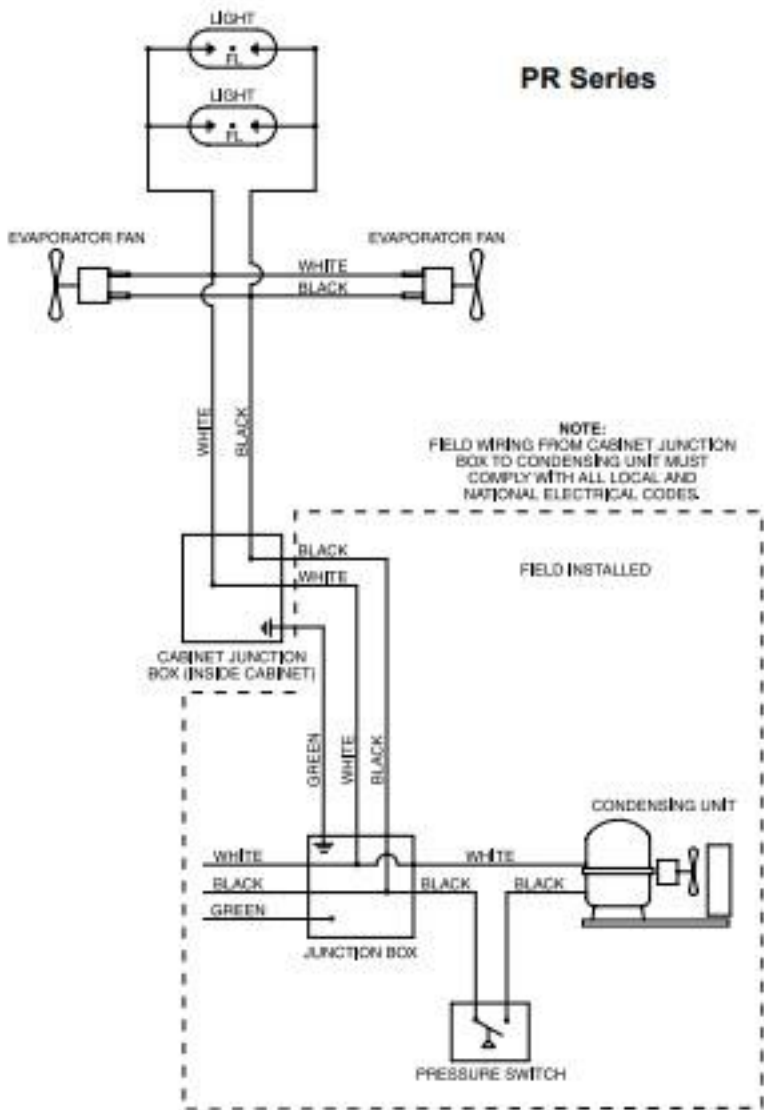

NOTE:
FIELD WIRING FROM CABINET JUNCTION BOX TO CONDENSING UNIT MUST COMPLY WITH ALL LOCAL AND NATIONAL ELECTRICAL CODES

FIELD INSTALLED

CABINET JUNCTION BOX (INSIDE CABINET)


JUNCTION BOX

CONDENSING UNIT

PRESSURE SWITCH

OPTIONAL ACCESSORY
ELECTRONIC CONDENSING UNIT

115V-1ph, 60hz, 150 WATTS




CAN ONLY BE USED
WITH MIN. 4" LEGS

CANNOT BE USED WITH PLATFORM
KIT OR BASEPLATE KITS

OPTIONAL ACCESSORY
ELECTRONIC CONDENSING UNIT

115V-1ph, 60hz, 150 WATTS



CAN ONLY BE USED
WITH MIN. 4" LEGS

CANNOT BE USED WITH PLATFORM
KIT OR BASEPLATE KITS