




1 WELL HOT COLD DROP-IN WIRING/LOGIC DIAGRAM 120, 208-240V

ITEM NUMBER
FC-6HC-01208-AD

WARNING – REQUIRED NEMA 14-20R
RECEPTACLE MUST BE WIRED
ACCORDINGLY OR CONDENSING
UNIT / AUXILIARY COMPONENT
DAMAGE WILL RESULT – WARRANTY
WILL BE VOID. TEST RECEPTACLE
PER THE FOLLOWING:


G, GROUND
X, LINE 1
Y, LINE 2
W, NEUTRAL

X-Y, 208-240V
X-W, 120V
Y-W, 120V



BLK & RED POWER
CORD WIRES ARE
INTERCHANGEABLE ON
PLUG TERMINALS X & Y

1 WELL HOT & COLD
WIRING DIAGRAM
120/208-240V

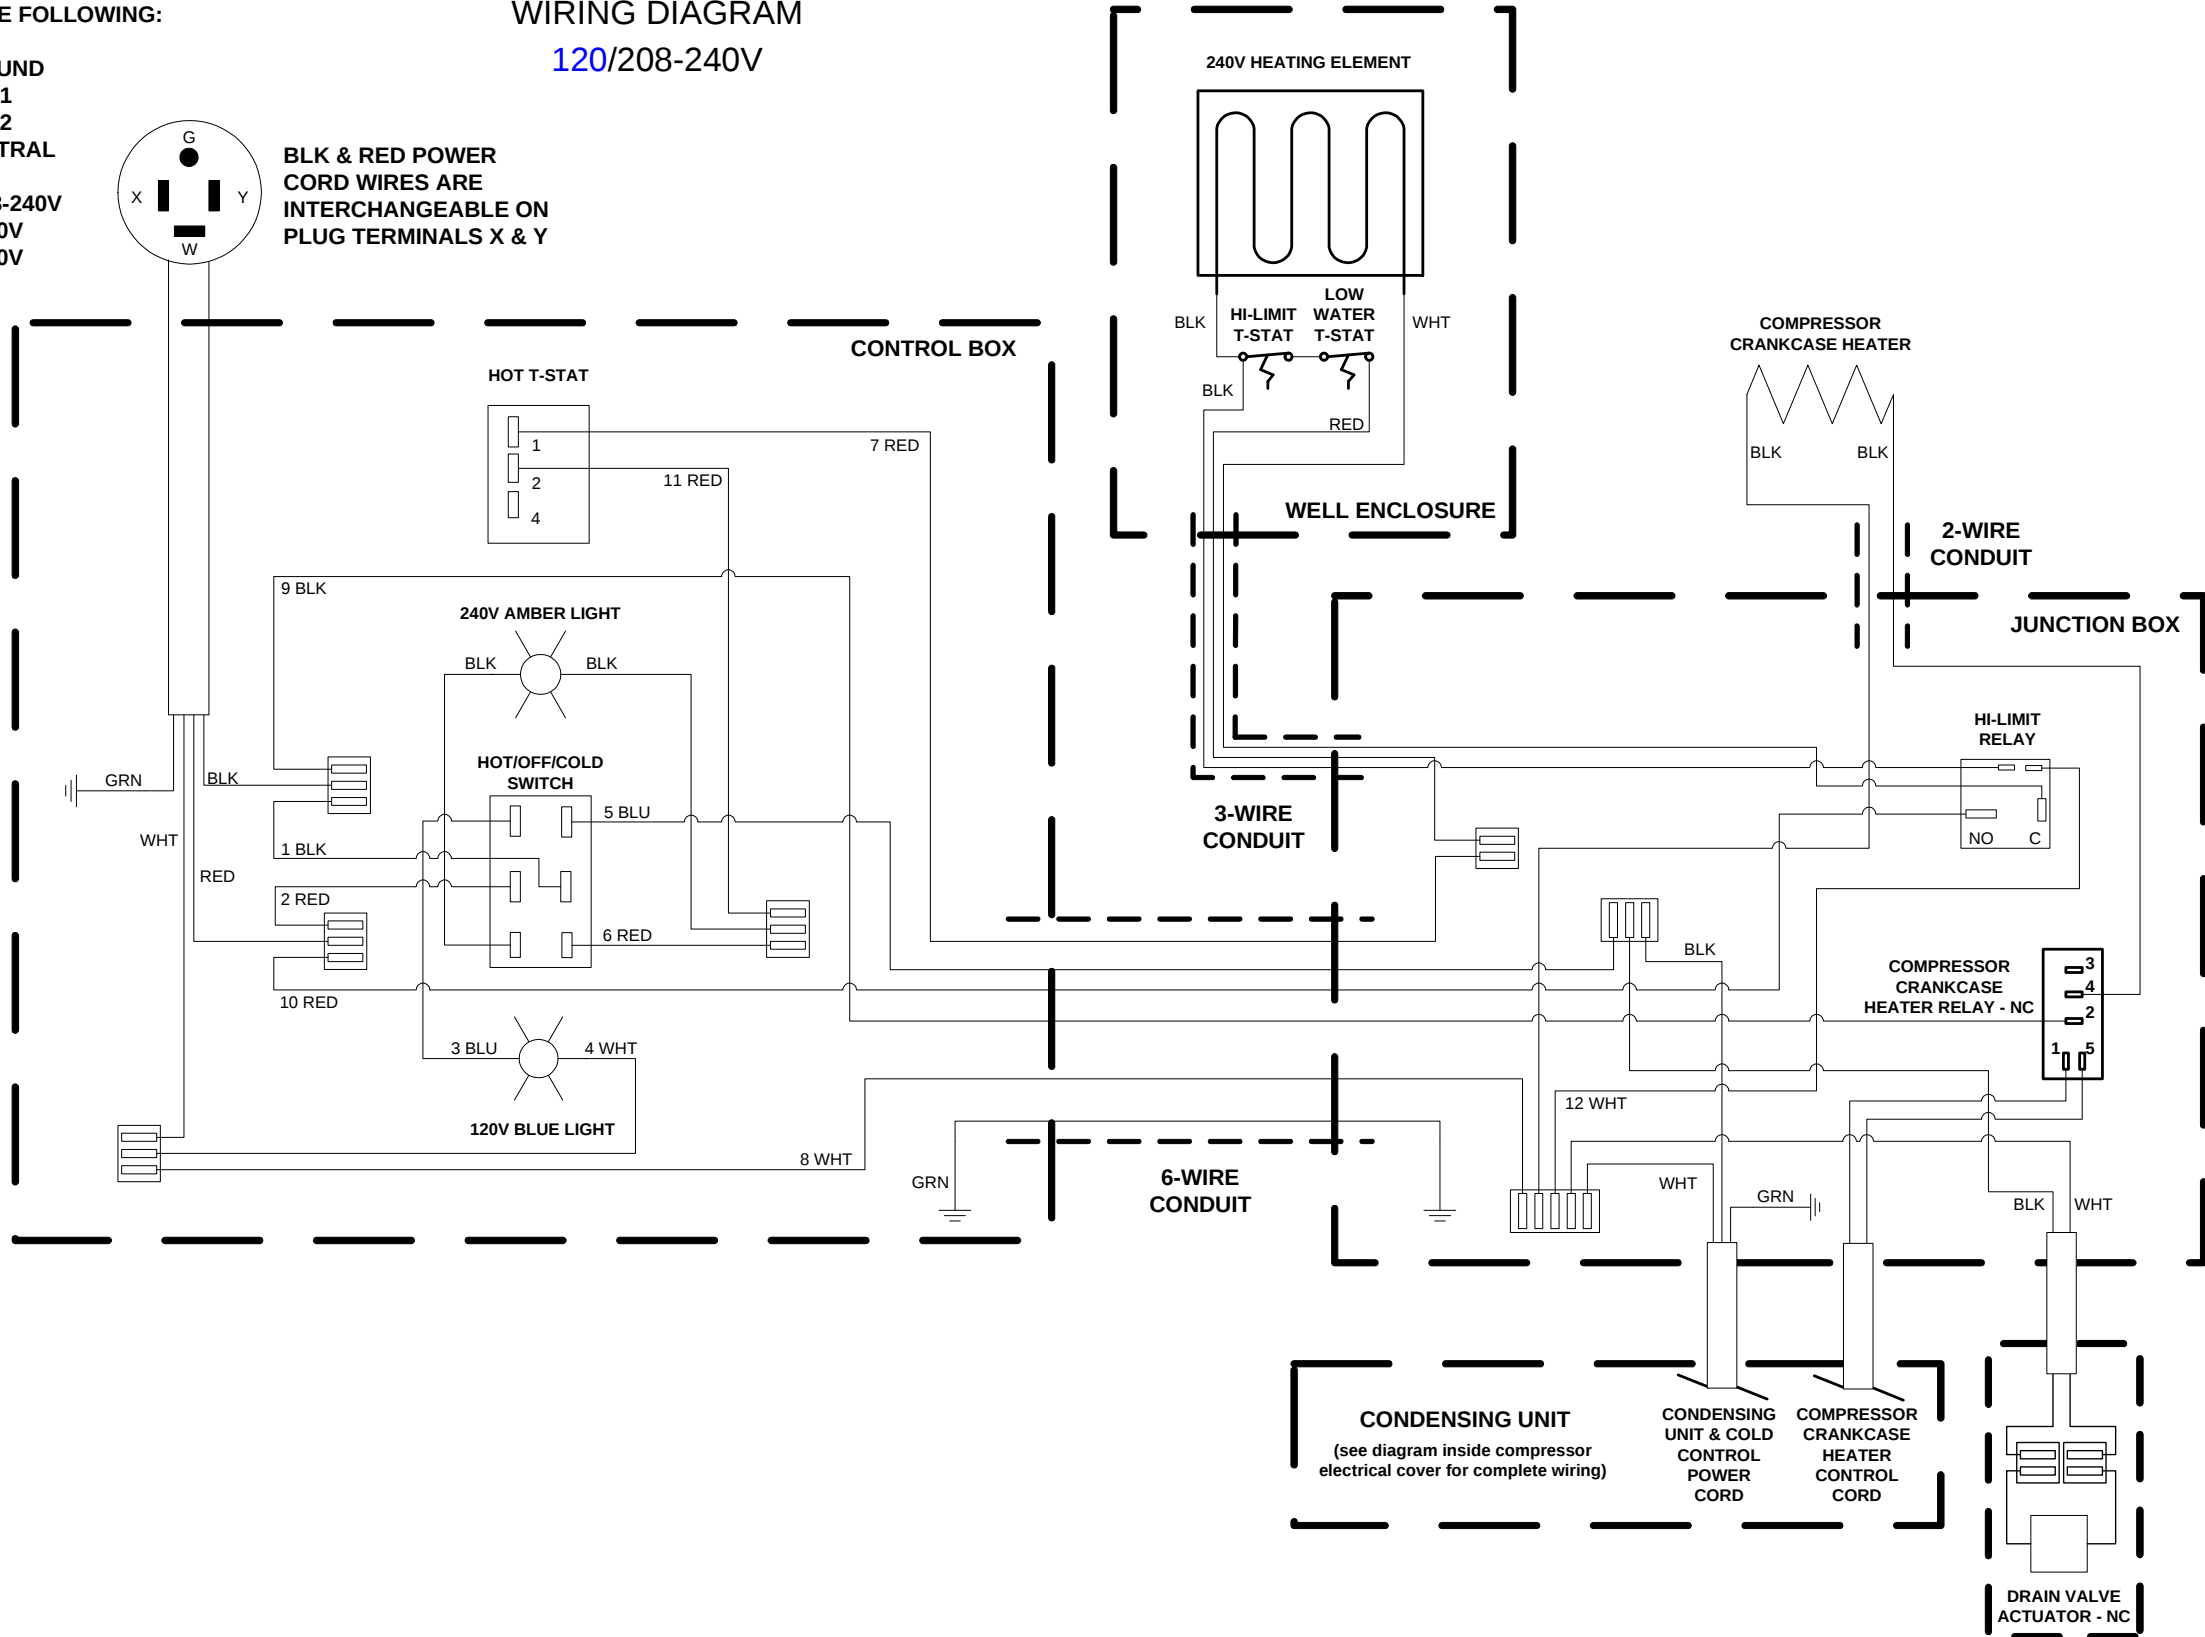



1 WELL HOT & COLD
120/208-240V LADDER LOGIC DIAGRAM

